

SUBMITTAL

MicroMetl

MicroMetl Special Roofcurb Adaptor
 Existing Unit: _____
 Configuration #: _____

Fax completed form to:
 Indianapolis, IN - 866-302-0410
 Attn: Tech Support
 Sparks, NV - 775-356-9184
 Attn: Tech Support

FORM NO. 4153-1P

DATE: 3/06

SUBMITTED TO _____
 COMPANY: _____
 DRAWN BY: B. Kahl
 JOB NAME: _____
 EQUIPMENT: _____
 NOTES: _____

DIRECTIONS:

- 1.) Determine dimensions of roofcurb for the proper configuration. Be sure to include Unit OEM and model number above.
- 2.) Label the supply and return air openings on the configuration drawing you are using. Label these **SA** for Supply and **RA** for Return.
- 3) Fax completed form to the location nearest you listed in the box in the upper right hand corner. Please include a cover sheet with contact information (name, phone, etc.), company, and job name.


Curb Adaptor Information

- Before new HVAC unit is set in place, inspect structural stability of existing curb and building's roof load capability. Reinforce if required.
- All curb adaptors will increase the systems external static pressure and must be included when calculating unit requirements.
- Curb adaptors are designed to attach to an existing curb with side x side duct connections. The curb adaptor is not designed for use with concentric duct configuration.


Features:

- Fully assembled curb adaptor.
- Includes internal duct transitions.
- Internally insulated with 1" - 1.5 lb insulation. Gasketing package provided.
- Corner welds are sealed.


Configuration 1

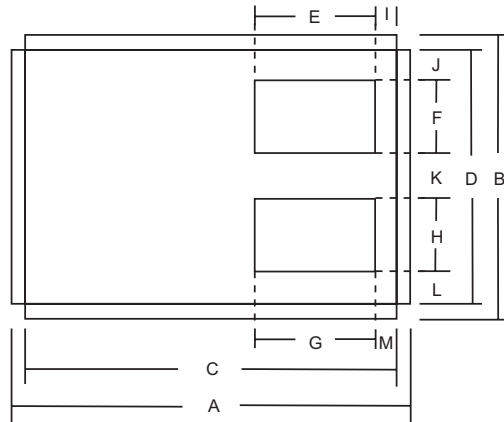


Configuration 2

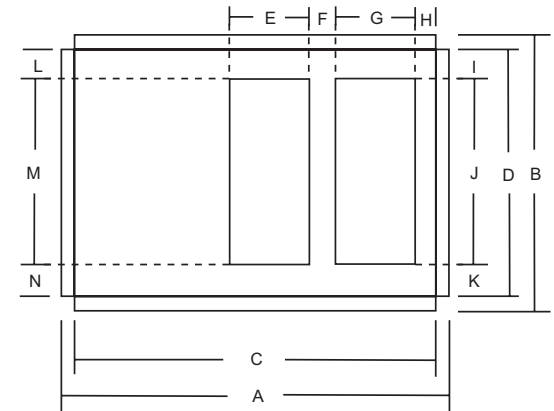

Configuration 3

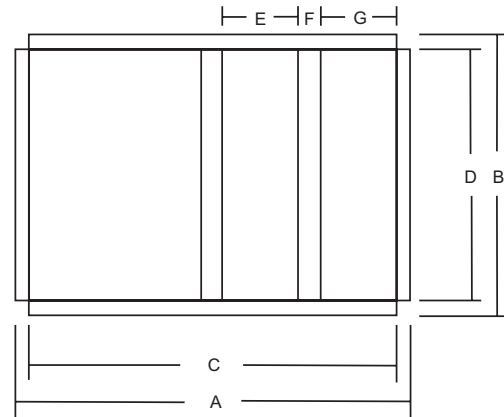

Configuration 4

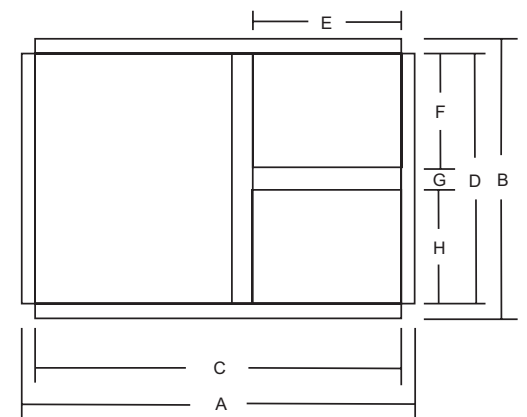

Dimensional Information (in inches)

A	B	C	D	E	F	G	H	I	J	K	L	M	N

THIS DOCUMENT IS THE PROPERTY OF MICRO METL CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT MICRO METL'S WRITTEN CONSENT.

SUBMITTAL

MicroMetl

MicroMetl Special Roofcurb Adaptor

New Unit: _____

Configuration #: _____

Fax completed form to:
 Indianapolis, IN - 866-302-0410
 Attn: Tech Support
 Sparks, NV - 775-356-9184
 Attn: Tech Support

FORM NO. 4153-1P

DATE: 3/06

SUBMITTED TO _____
 COMPANY: _____
 DRAWN BY: B. Kahl
 JOB NAME: _____
 EQUIPMENT: _____
 NOTES: _____

DIRECTIONS:

- 1.) Determine dimensions of roofcurb for the proper configuration. Be sure to include Unit OEM and model number above.
- 2.) Label the supply and return air openings on the configuration drawing you are using. Label these **SA** for Supply and **RA** for Return.
- 3) Fax completed form to the location nearest you listed in the box in the upper right hand corner. Please include a cover sheet with contact information (name, phone, etc.), company, and job name.


Curb Adaptor Information

- Before new HVAC unit is set in place, inspect structural stability of existing curb and building's roof load capability. Reinforce if required.
- All curb adaptors will increase the systems external static pressure and must be included when calculating unit requirements.
- Curb adaptors are designed to attach to an existing curb with side x side duct connections. The curb adaptor is not designed for use with concentric duct configuration.


Features:

- Fully assembled curb adaptor.
- Includes internal duct transitions.
- Internally insulated with 1" - 1.5 lb insulation. Gasketing package provided.
- Corner welds are sealed.


Configuration 1

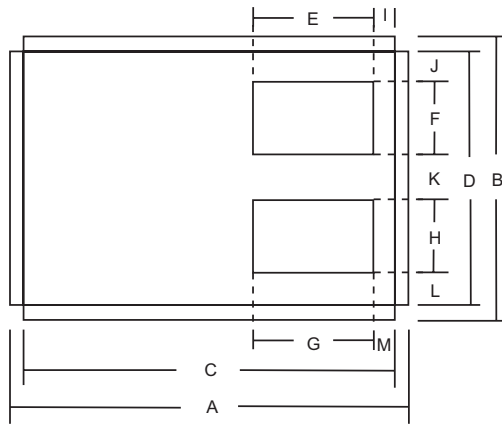


Configuration 2

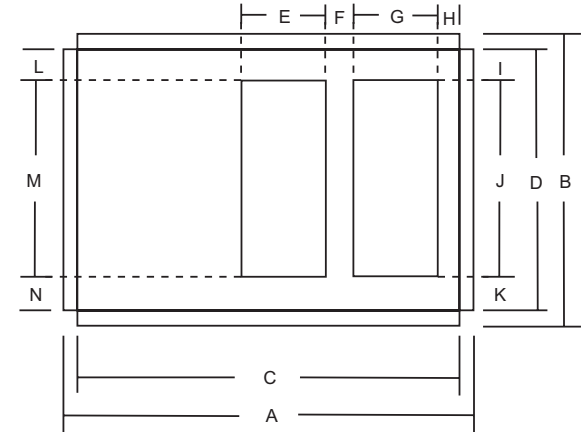

Configuration 3

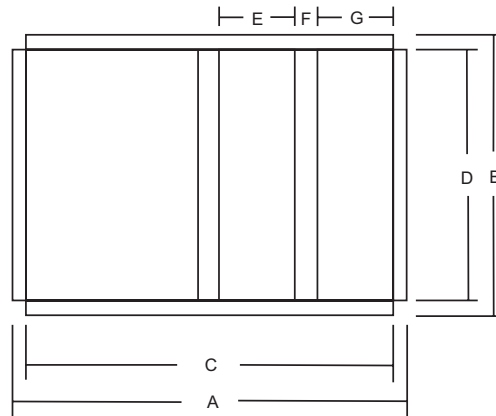

Configuration 4

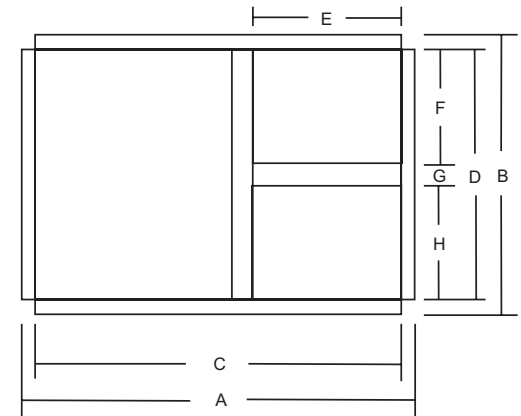

Dimensional Information (in inches)

A	B	C	D	E	F	G	H	I	J	K	L	M	N

THIS DOCUMENT IS THE PROPERTY OF MICRO METL CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT MICRO METL'S WRITTEN CONSENT.